


**EXAMPLE MATERIAL LIST**

1	100mm DIA CLASS '12' UPVC RRJ PRESSURE PIPE
2	50mm DIA CLASS '12' UPVC RRJ PRESSURE PIPE OR
2	63mm DIA CLASS '12' POLYETHYLENE PRESSURE PIPE
3	100mm DIA. CONNECTOR RRJ (FL - SOC) TO SUIT UPVC
4	100mm DIA INSERTION SET (COMPLETE)
5	100mm - 80mm DIA CONCENTRIC TAPER (FL-FL)
6	80mm DIA SLUICE VALVE (FL-FL)
7	80mm DIA INSERTION SET (COMPLETE)
8	80mm - 80mm x 80mm DIA. TEE (FL-FLxFL)
9	80mm DIA x 600mm LONG HYDRANT RISER
10	80mm DIA x 375mm LONG HYDRANT RISER
11	80mm DIA SPRING TYPE HYDRANT
12	RECYCLED PLASTIC SURROUND WITH CAST IRON LID (HYDRANT)
13	HYDRANT INDICATOR POST
14	50mm DIA. COMPRESSION COUPLING
15	50mm DIA. x 150mm LONG S/S PIPE (BSP THREAD ONE END)
16	80mm DIA BLANK FLANGE (TAPPED TO 50mm B.S.P.)
17	50mm DIA. GALV' VALVE SPINDLE EXTENSION (375mm LENGTH)
18	100mm DIA SH/SW UPVC SLEEVE
19	RECYCLED PLASTIC SURROUND WITH CAST IRON LID (VALVE)
20	VALVE INDICATOR POST
21	50mm DIA x BEND (SOC-SOC) TO SUIT UPVC

**EXAMPLE COURT BOWL**

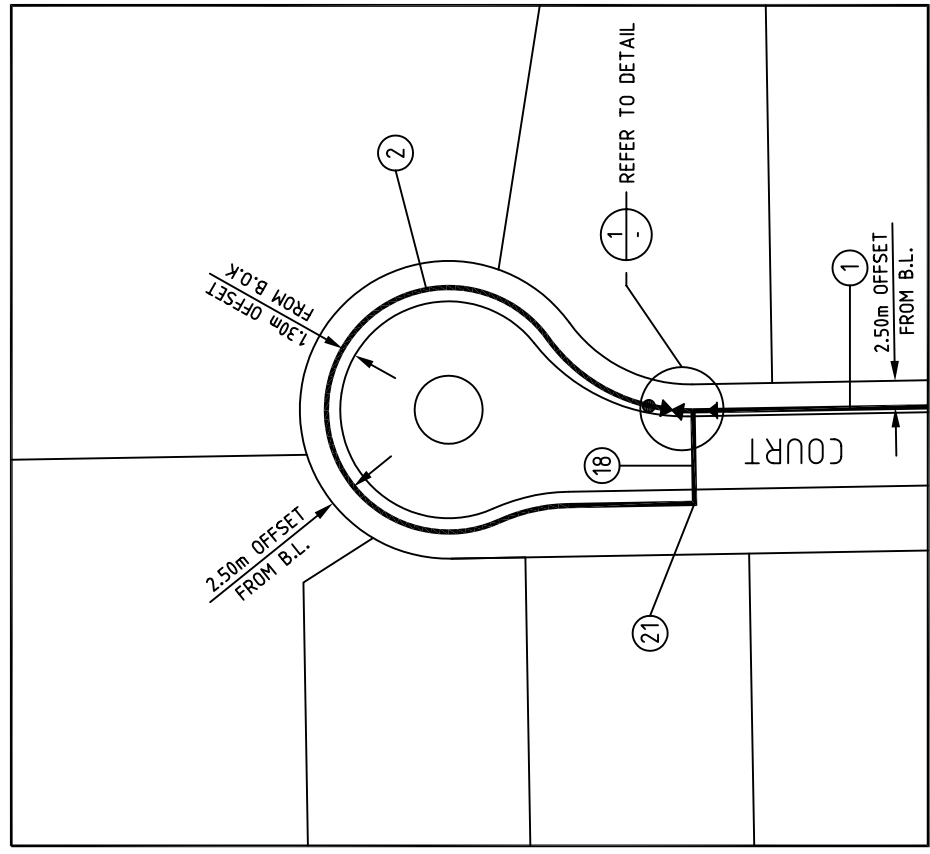


CAD: \STANDARD\WAT-1121-G-(a)

SHEET	1	OF	1
GLA No.	-		

REVISION			
-			
DRAWING NUMBER			
WAT-1121-G-(a)			

WATERMAIN TYPICAL ARRANGEMENT IN COURT BOWL - 63Ø PE OR 50Ø UPVC MAIN STANDARD DRAWING



SCALE  
N.T.S



104-110 FRYERS STREET, SHEPPARTON, 3630  
(P.O. BOX 185, SHEPPARTON, 3632)  
PH. (03) 5632 0400 FAX. (03) 5631 1467

REV.	AMENDMENT DESCRIPTION	BY	APP.	DATE	DESIGN	DRAWN	R. PAOLINI	CHECKED	APPROVED
					SURVEYED		JAN 2003	DATE	DATE