


DO NOT SCALE DRAWING

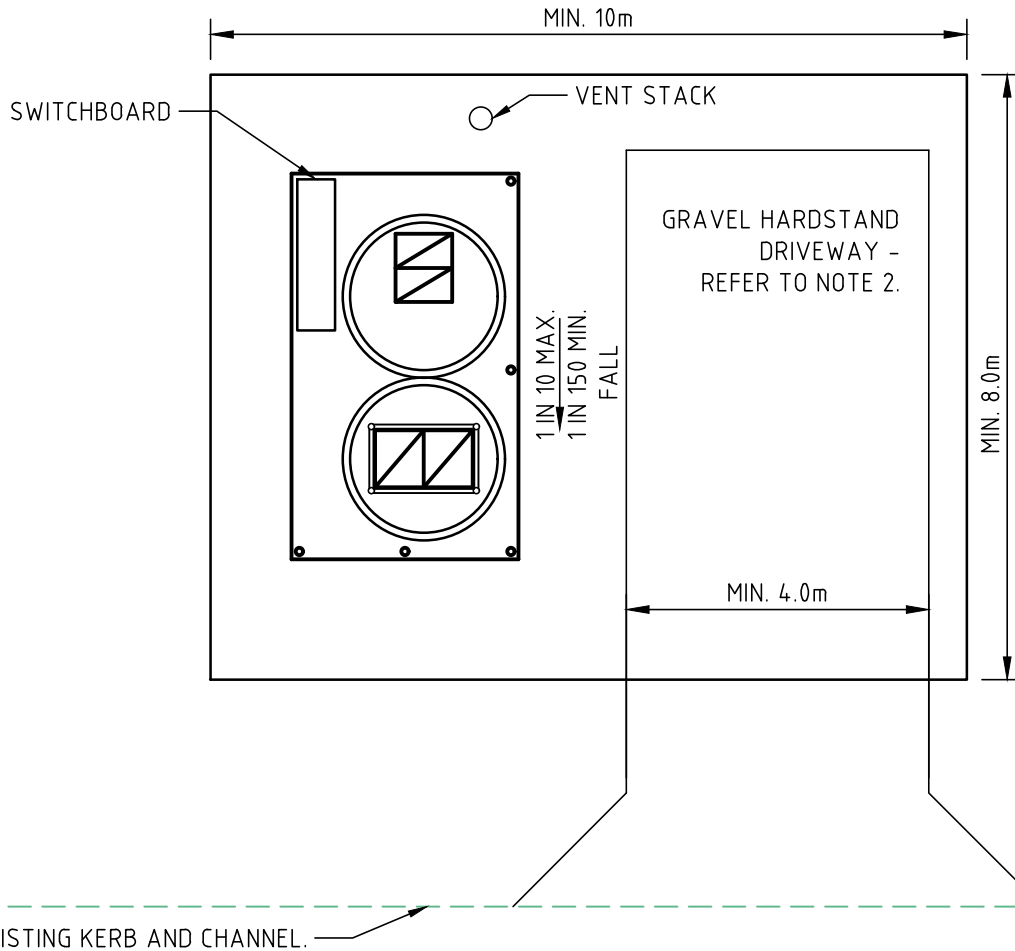

NOTES:

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH GVW STANDARD DRAWINGS.
2. DRIVEWAY ACCESS TO ALL PUMP AND LIFT STATIONS SHALL BE PROVIDED AS FOLLOWS:
 - 2.1. LONGITUDIANL GRADE SHALL BE MAXIMUM 10%.
 - 2.2. LOCATED SO VEHICULAR TRAFFIC WILL NOT TRAVERSE THE COVERS.
 - 2.3. HEAVY VEHICLE ACCESS DRIVEWAYS SHALL BE GRAVEL HARDSTAND.
3. THE PUMP AND LIFT STATION SITE AREA SHALL BE A MINIMUM OF 80M² OR AS DIRECTED BY GVW. THE SURROUNDS SHALL BE LANDSCAPED WITH SHRUBS AND MULCH. INTERNAL LANDSCAPING - WEED MAT AND MULCH.
4. PUMP STATION PLATFORM SHALL BE PROFILED TO SLOPE 1:100 AWAY FROM OPENINGS AND SWITCHBOARD PLINTH AND THEN BATTER AT 1 IN 6 (MAX.) TO NATURAL SURFACE.
5. WHERE REQUIRED BY GVW PROVIDE A 1.8m HIGH PERSON PROOF FENCE AND 4.0m WIDE DOUBLE LEAF LOCKABLE GATE.
6. DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
7. FLOOD LEVELS MUST BE CONSIDERED TO DETERMINE LEVELS OF ACCESS ROAD AND TOP OF CONCRETE SLAB.

Z: \STANDARD\S-21



104-110 FRYERS STREET, SHEPPARTON, 3630
 (P.O. BOX 185, SHEPPARTON, 3632)
 PH. (03) 5832 0400 FAX. (03) 5831 1467

**STANDARD DRAWING
 TYPICAL PUMP STATION SITE
 LAYOUT**

SHEET 1 OF 1

REVISION
 -

DRAWING NUMBER
S/21

SCALE 1: 100	DRAWN	M. WEBBER	APPROVED	-
	DATE	JUNE 2018	DATE	-